


**R1 AND R2
DIP SWITCH**

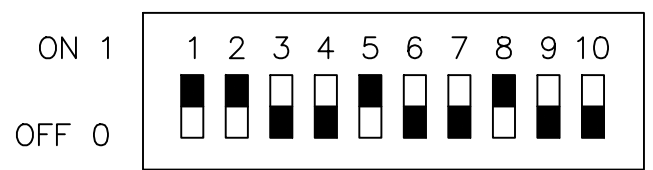

- NOTE**
- 1) FAULT RELAY IS ENERGIZED DURING NORMAL OPERATION.
 - 2) FIRE RELAY ENERGIZES WHEN FIRE IS DETECTED.
 - 3) RESISTOR 47k.

LEAVE CABLES COILED UP NEAR FACP.

NOTES



6				PROJECT	
5				BEAM DETECTOR WIRING	
4					
3					
2				TITLE	SAMPLE
1	AA	ISSUED FOR REVIEW.	YY/MM/DD		
#	BY	DESCRIPTION	DATE	DRAWN	BB
				DATE	YYYY/MM/DD
	PHONE			CHKD	CC
	OFFICE			CONTRACT #	N/A
				SCALE	NTS
				DWG. #	1 of 1